



1/5

# ලංකා බන්ධන තෙල් නීතිගත සංස්ථාව

(වර්ෂ 1961 අංක 28 දරණ පාර්ලිමේන්තු පනතින් ස්ථාපිත කරන ලදී.)  
පිරිපහදු කාර්යාලය, තැ.පෙ. 11, කැලණිය

இலங்கை பெற்றோலியக் கூட்டுத்தாபனம்  
(1961ம் ஆண்டின் 28ம் இலக்க பாலாளுமன்ற  
சட்டத்தின்படி அமைக்கப்பட்டது)  
எண்ணெய் கத்திகரிப்புப் பிரிவு  
த. பெ. இலக்கம் 11, களணிய.

THE CEYLON PETROLEUM CORPORATION  
(Established by Act of Parliament No. 28 of 1961)  
Refinery Division, P.O. Box 11, Kelaniya.  
Tel : 2400110, 2400427-29 Fax : 2400102, 2400436  
E-mail : ref.materials@ceypetco.gov.lk  
refmaterials@sltnet.lk

## REQUEST FOR QUOTATION

Our Ref:GL1 - SP18-084  
Date:14.05.2018

Please quote Price for DELIVERY AT REFINERY SAPUGASKANDA and submit your sea quotation marked with our reference & closing date on the left hand top corn Furnish samples/ catalogues/ information as requested below. Your quotation should reach us ON OR BEFORE 07-06-2018 - 2.30 PM. ANY DEVIATIONS SHOULD INDICATED CLEARLY.

Quotations received after closing date are liable to be rejected. Payment will made within 30 DAYS of delivery. Please indicate VAT registration No. amount separately if applicable. Your offer should be valid for 15th August 2 from closing date. Country of origin & delivery date to be mentioned against each item. Please comply with our general conditions & instructions given.

AS PER ATTACHED SPEC. & DRAWING SHEETS

Thanking You,  
Yours Faithfully,

  
Manager (Materials) / Deputy Manager (Planning)

(To be completed by supplier)

Item No	Qty	Unit	Description	Unit Price	Amount (Without VAT)
001	1	EA	MOTOR CONTROL CENTRE ENCLOSURE AS PER GIVEN SPECIFICATIONS AND CPC DRAWING NO. 8907		
Total Without Tax				----	
(if any) ...%NBT----					
(if any) ...%VAT----					
Total Amount with NBT+VAT----					

UNSIGNED BIDS WILL BE REJECTED

To: Ceylon Petroleum Corpn.

We submit the foregoing quotations on the terms and conditions mentioned above

2/5

REQUEST FOR QUOTATION

(Con


Our Ref:GL1 - SP18-084

Item No	Qty	Unit	Description	Unit price	Amou
				(Without VAT)	

The quotation remains open for acceptance either wholly or in part by you. offer is valid till .....


Our Tel./Fax.....  
VAT No.....

Signed.....  
Company Stamp

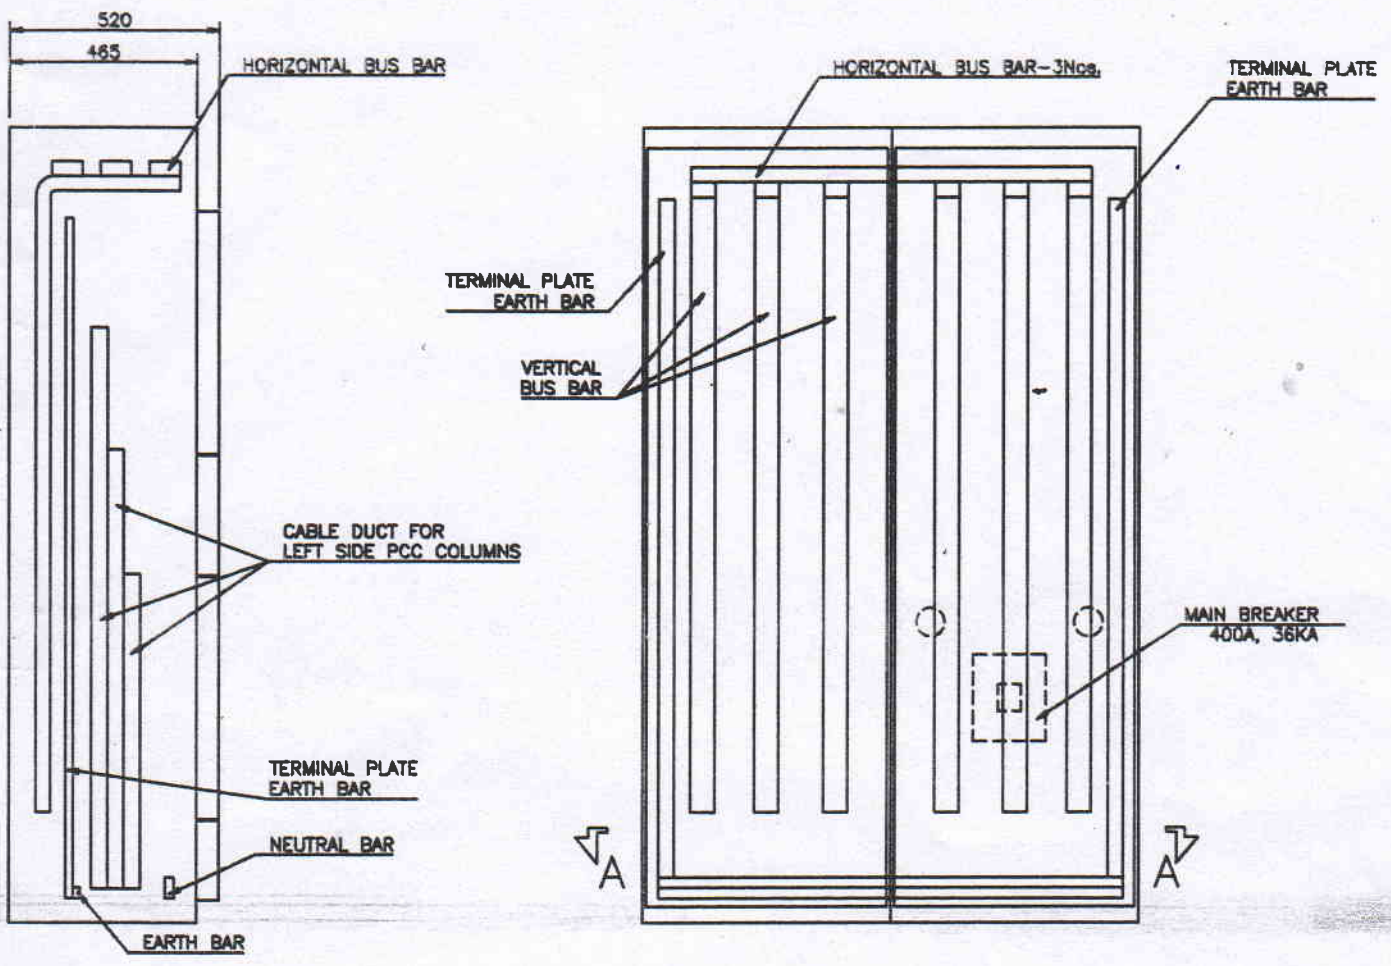

SECTION "C-C"


BUS-BAR ARRANGEMENT

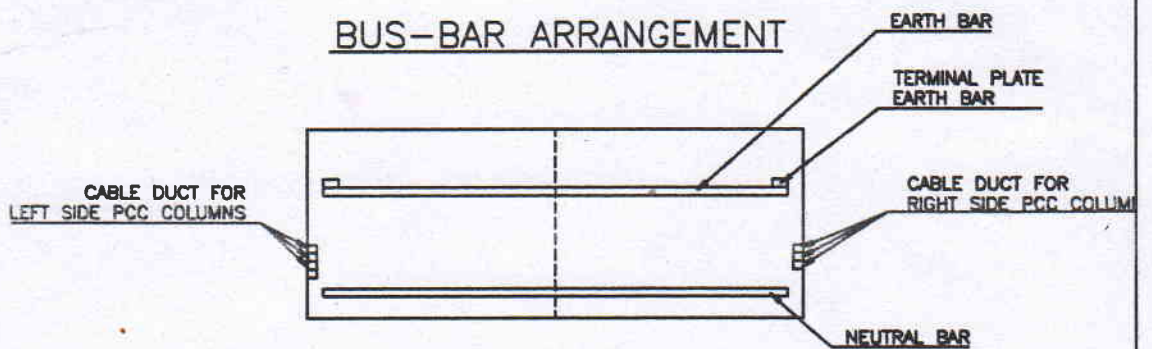

SECTION - "A-A"

A							FOR TENDER PURPOSE ONLY
0	20.1.14	E.N.					FOR COMMENTS
REV.	DATE	BY	CHK'D	APPROVED	DESCRIPTION		
MCC PANEL FOR LPG YARD							
LOCATION: REFINERY						PROJ. No. 1815	
CEYLON PETROLEUM CORPORATION REFINERY DIVISION SAPUGASKANDA.						SCALE: NTS	
						DWG No. 8907	

4/5

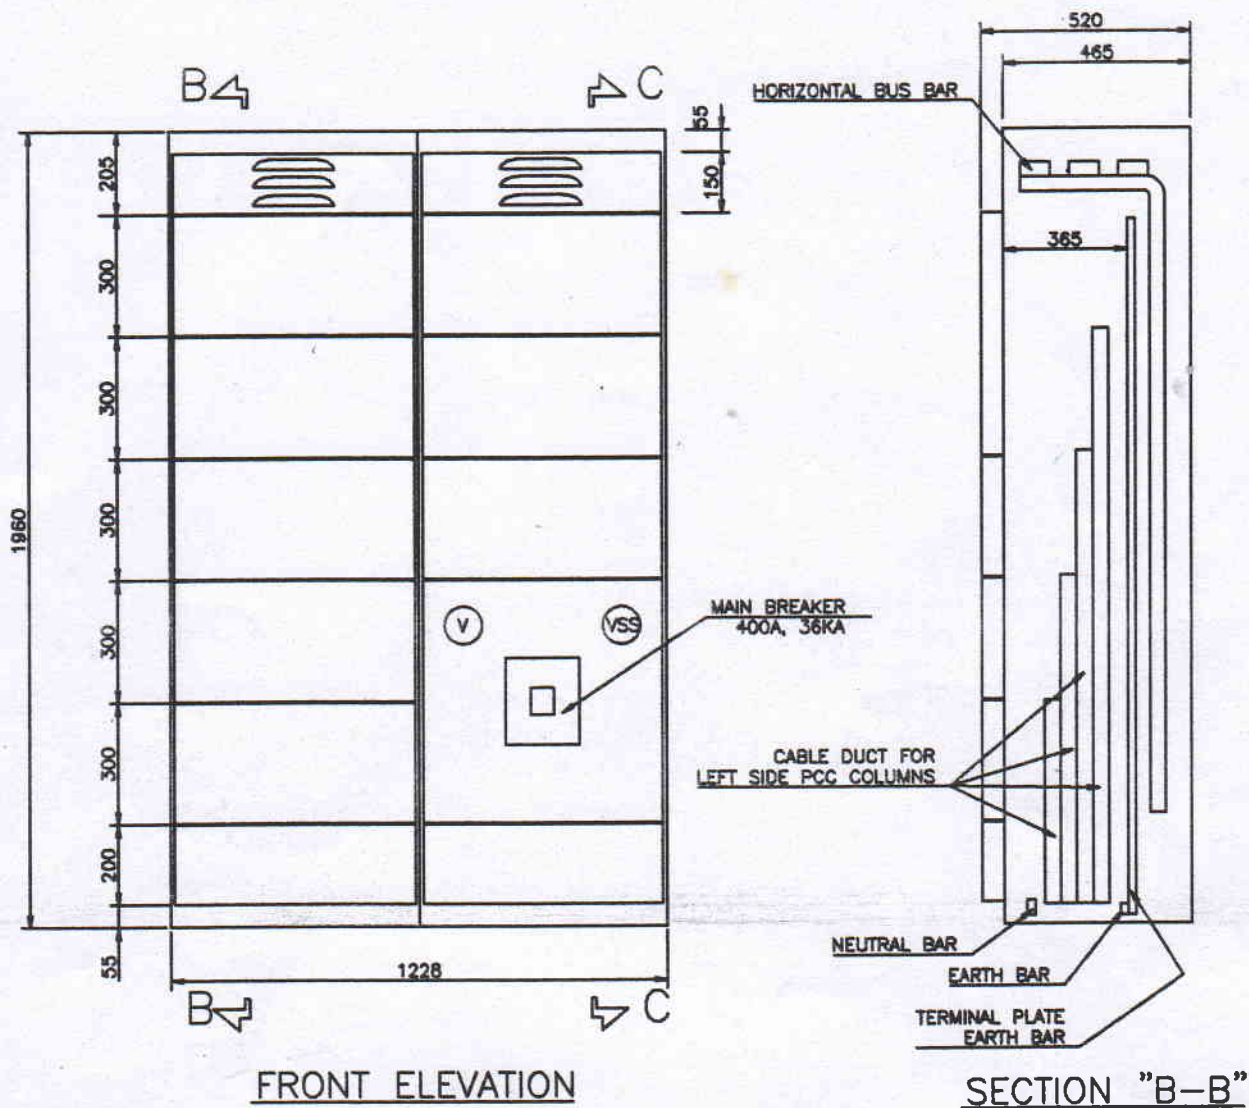

**FEATURES**

1. PROTECTION	DUST TIGHT ENCLOUSER
2. INCOMING CABLES	FROM BOTTOM
3. COPPER BARS	SHEATHED
4. BAR CONNECTION	BARE (ELECTROPLATED)
5. HORIZONTAL BUS BARS :TOP	CROSS SECTION 3x1 (50x6)
6. VERTICAL BUS BARS	CROSS SECTION 3x1 (50x6)
7. HORIZONTAL NEUTRAL BUS BARS :BOTTOM	CROSS SECTION 1 (30x5)
8. HORIZONTAL EARTH BUS BARS BOTTOM	CROSS SECTION 1 (30x5)
9. VERTICAL EARTH BUS BARS	CROSS SECTION 1 (15x3)

**1. Scope**

To supply 01 nos of Motor Control Centre Enclosure as per given CPC drawing no. 8907.

5/5

**2. Specification****• Bus bar**

Capacity : 600 A (Insulated)  
Material : Pure copper

**• Main breaker**

Capacity : 400 A (Adjustable Thermal Trip Type)  
Poles : 4  
S/C Capacity : 36 kA  
Voltage : 400 V , 50 Hz .  
Make : ABB or SIEMENS  
Protection : Overload, Short Circuit

**3. Service Condition**

Maximum ambient temperature : 50°C  
Average ambient temperature : 40°C  
Altitude : Less than 1000m  
Humidity : 95% non condensing  
Atmosphere : Corrosive and Dusty  
Location : Petroleum Refinery

**4. Expected Features**

Enclosure Dimensions : As per drawing CPC drawing no . 8907

Plate Thickness : 2 mm

Door & Lock : Door to be supported by hinges and opened on to a sideway with a quarter turn lock for common panel key

Door gasket : Should be of oil resistant make

Internal mounting plate : Required ( see the drawing 8907)

**5. General Conditions**

- Printed product catalogues, Dimensional drawings and technical details in English language are to be provided along with the offer.
- Minimum of one (1) year warranty is required for the offered equipment.
- It is the total responsibility of the bidder to inspect the similar MCC panel at Refinery Sapugaskanda before quoting.

J